



Art.-Nr: KLU013WLSE
Exit sign Single Battery
Universal, Wireless Professional, 3 h, 34 m, IP43, Plastic,
white

Slim design high-grade plastic luminaire for universal mounting (wall/ ceiling or as wall bracket with the included adapter). This luminaire provides additional downwards lighting to enhance safety at the egress route. Applicable for maintained or non-maintained operation mode. The easy to install and universally useable pictograms provide planning security. Signs according EN 60598-1, EN 60598-2-22 and EN 1838 norms.



More information




TECHNICAL DATA

Luminaire type	Exit sign
Mounting	Universal
Recognition distance	34 m
Pictograph	Set
Illuminant	LED
Housing material	Plastic
Housing color	white
Protection type (IP)	IP43
Impact resistance (IK)	≥ 3
Certification	WEEE, CE
Insulation class	2
Supply	Single Battery
Monitoring	Wireless Professional
Bridging time	3 h
Battery	battery pack, 12V/0,8Ah NimH, 300mm wire dimension L40xW45xD30mm (LEX)
Operating mode	Standby circuit / permanent circuit
Input voltage AC	230 V
Input frequency	50 / 60 Hz
Input voltage DC	- V
Power max.	7,5 W



Power DS	7,5 W
Power BS	3,6 W
Ambient temperature DS	-5 °C - 40 °C
Ambient temperature BS	-5 °C - 40 °C
Depth	78 mm
Width	390 mm
Height	220 mm
Weight	1.57
Weight incl. packaging	1.73
Connection cross-section	2.5 mm ²
Switching input	Yes
Emergency light blocking	No
Battery connection	Clip
Dimming function	Yes
Luminous flux mains	150 lm
Luminous flux emergency	150 lm
Customs tariff number	94056120
EAN	4260682147707

TECHNICAL DRAWING

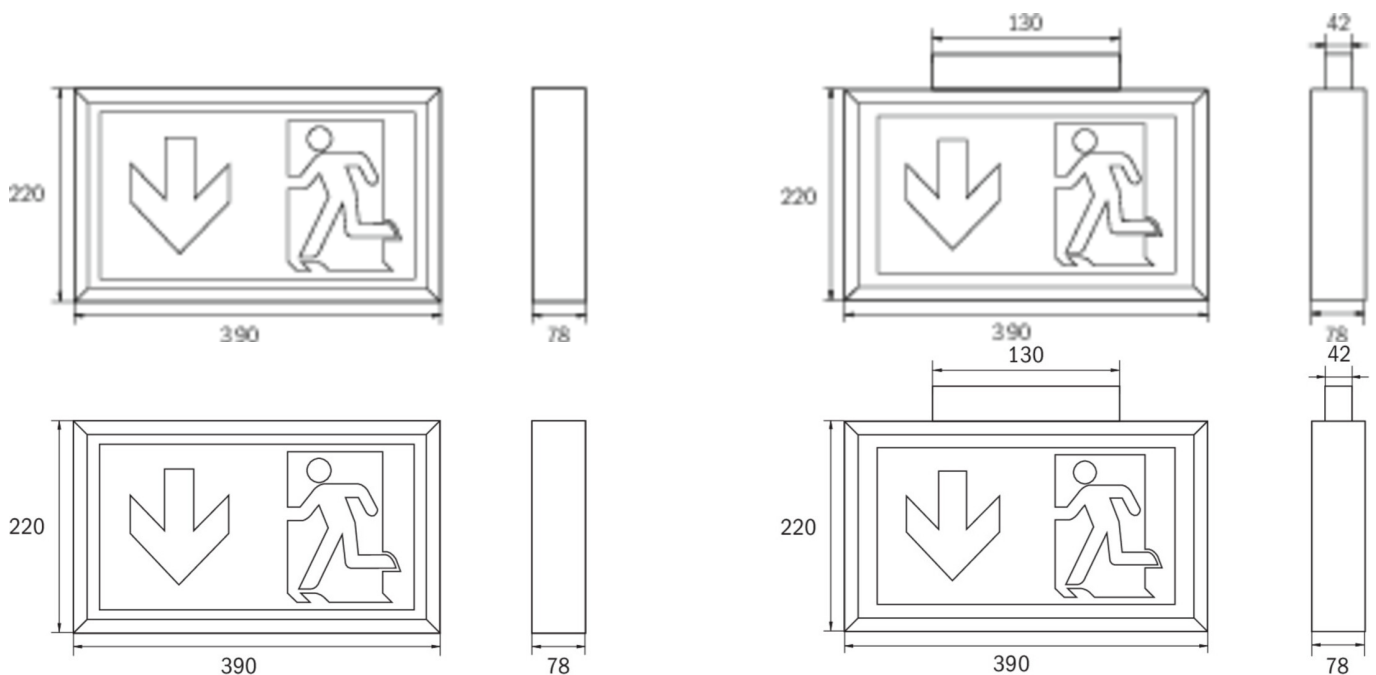







ACCESSORY LIST

DSA -
BALL2 -
2PW-EB -
2DW-EB -

RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
KLU013		CPS								
KLU013BC		Bus control								
KLU013SC		SelfControl	Single battery		€	no	high	no	unlimited	itself
KLU013WL		Wireless Professional	Single battery		€€	yes	low	yes	1,000 per system	central

As of: 18.07.2024 - Subject to technical changes and errors.