



Art.-Nr: KWID039ML
Exit sign, Safety luminaire Centralised power supply systems
Ceiling, Central power supply (ML), CPS, 16 m, IP65, Plastic,
white

Classic bar-shaped polycarbonate luminaire for ceiling mounting. Straight lines as well as the robust construction with a high ingress protection allow versatile use.

Control and monitoring via central power supply system. The innovative integrated lens holder with a rapid fitting fixture permits the flexible use of various lens types. Using the right lens allows the distribution of light to be matched perfectly to the application and simplifies illumination which satisfies all relevant standards. A round lens and hall lens are supplied with every luminaire, allowing it to be adapted perfectly to the respective mounting situation. Other lenses, such as a spotlight lens, beam lens or H lens, are available as options.



More information
www.rp-group.com/en/item/KWID039ML



TECHNICAL DATA


Luminaire type	Exit sign, Safety luminaire
Mounting	Ceiling
Recognition distance	16 m
Pictograph	Set
Illuminant	LED
Housing material	Plastic
Housing color	white
Protection type (IP)	IP65
Impact resistance (IK)	6
Certification	CE, WEEE, D-Sign
Insulation class	2
Supply	Centralised power supply systems
Monitoring	Central power supply (ML)
Bridging time	CPS
Battery	/
Operating mode	single luminaire switching
Input voltageAC	230 V



Input frequency	50 / 60 Hz
Input voltage DC	216 V
Power max.	9,4 W
Power DS	9,4 W
Power BS	1,1 W
Ambient temperature DS	-35 °C - 40 °C
Ambient temperature BS	-20 °C - 40 °C
Depth	93 mm
Width	390 mm
Height	139 mm
Weight	0.77
Weight incl. packaging	0.87
Connection cross-section	2.5 mm ²
Switching input	Yes
Emergency light blocking	No
Battery connection	No
Dimming function	Yes
Luminous flux mains	1050 lm
Luminous flux emergency	1050 lm
Customs tariff number	94056120
EAN	4260659566333



TECHNICAL DRAWING

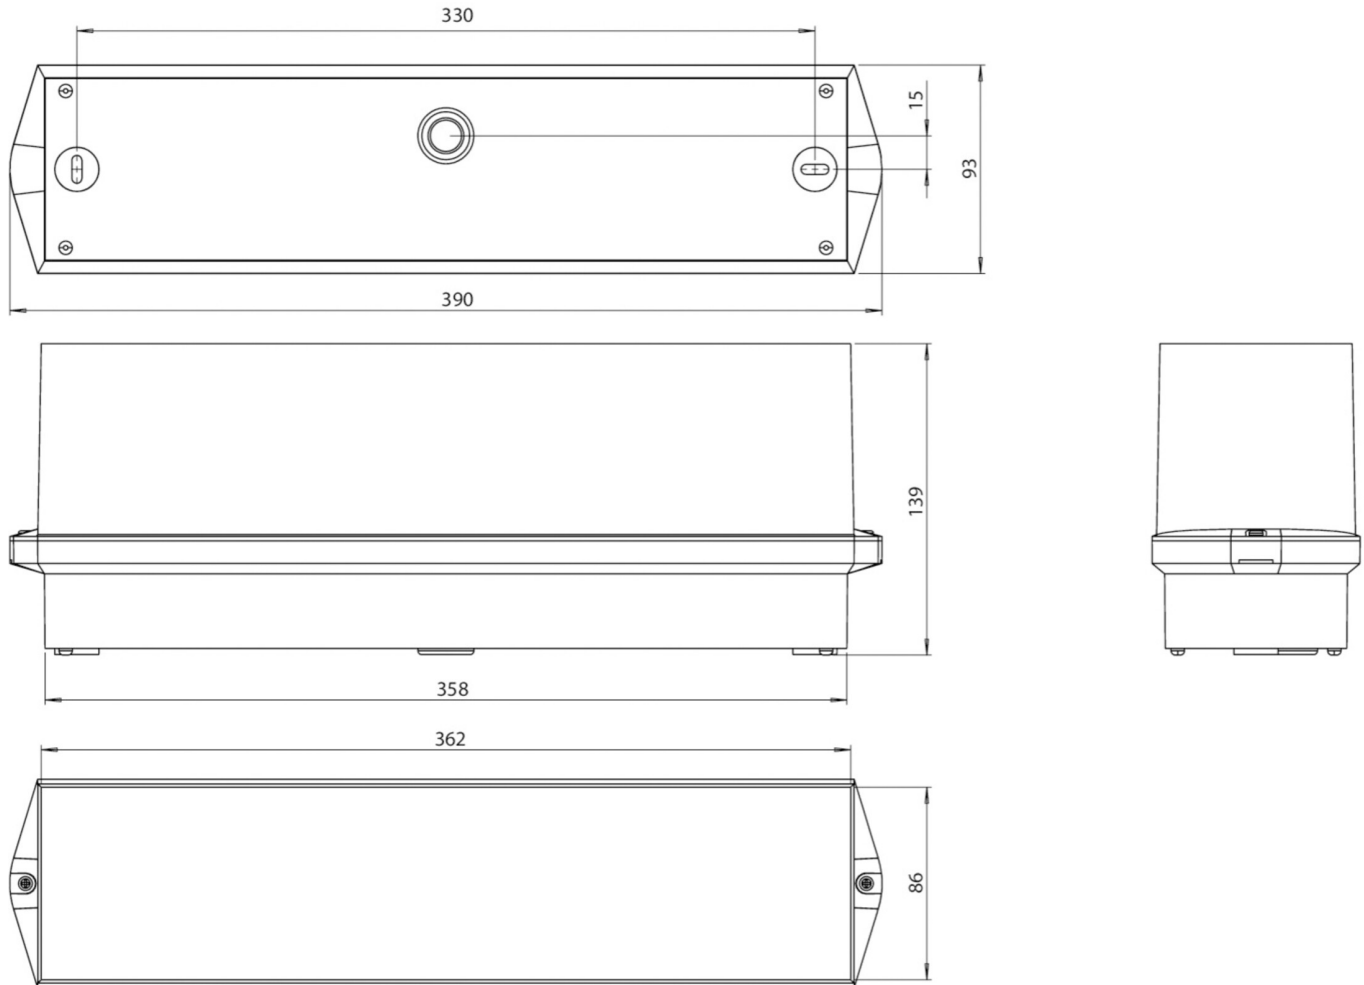

ACCESSORY LIST

BKW -

RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
----------	-------	------------	--------	-------	------------	---------------	-------------------	--------------------	-----------------	-----------------------------

As of: 23.08.2024 - Subject to technical changes and errors.